

REMOVABLE DUCT SECTIONS

DUCT ACCESS • MAINTENANCE • CLEANING



RDS X1



SB-1 X2

CD X2

Comprised of a Removable Duct Section (RDS), two Linx Transfer Couplings (CD), and two gasketed Linx Transfer Barrel Clamps (SB-1), this assembly creates an airtight, removable section within an existing duct run.

Simply remove the clamps and RDS for easy access.

The Ideal Solution For:

- In Duct Access and Cleaning
- Smoke Detector Inspections
- Fire and Smoke Damper Inspections

100% Code Compliance:

- IMC 607.4
- IBC 717.4.1
- NFPA 80 19.2.3
- NFPA 105 6.3.2

See Reverse Side for Specifications and Installation Instructions



1-800-797-7476

li-hvac.com


orders@li-hvac.com

Smart Part Numbers

Dia (Inch)	G90 Galvanized	316 Stainless Steel	G90 Galvanized Double Wall*	L1 (Inch)	L2** (Inch)
6	06RDSG924	06RDSS624	I106RDSG924	9	14
8	08RDSG924	08RDSS624	I108RDSG924 </td <td>14</td> <td>18</td>	14	18
10	10RDSG924	10RDSS624	I110RDSG924	14	18
12	12RDSG924	12RDSS624	I112RDSG924	14	18

* Double Wall Construction Has Solid Inner Liner and R4 Fiberglass Insulation

** Nominal Dimensions Indicated

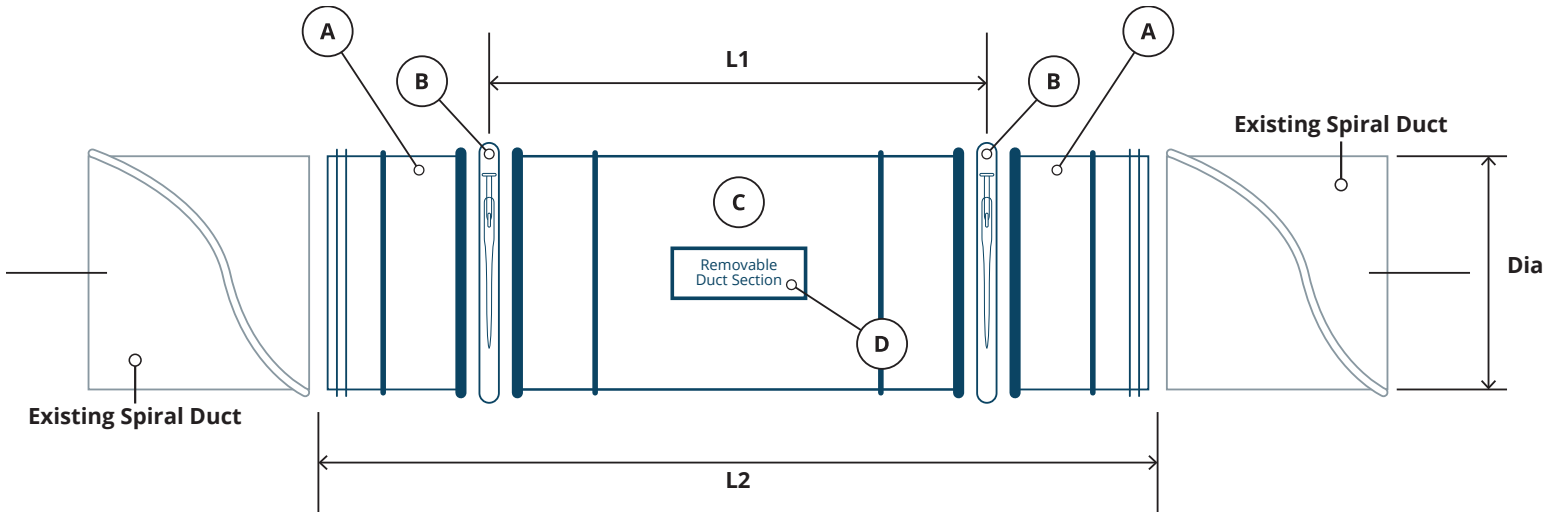

RDS Kits Contain:

- A. Coupling with EPDM Rubber Gasket x2
- B. Clamp with EPDM Rubber Gasket x2
- C. Removable Duct Section x1
- D. Label for Removable Duct Section x1

To Install and Use:

1. Cut L2 length from existing duct
2. Insert Couplings (A) and secure to existing duct (no sealant required)
3. Insert RDS (C) and secure with Clamps (B) in two places

To Access:

1. Remove both Clamps (B) and remove the RDS (C) for access

